


PLAN

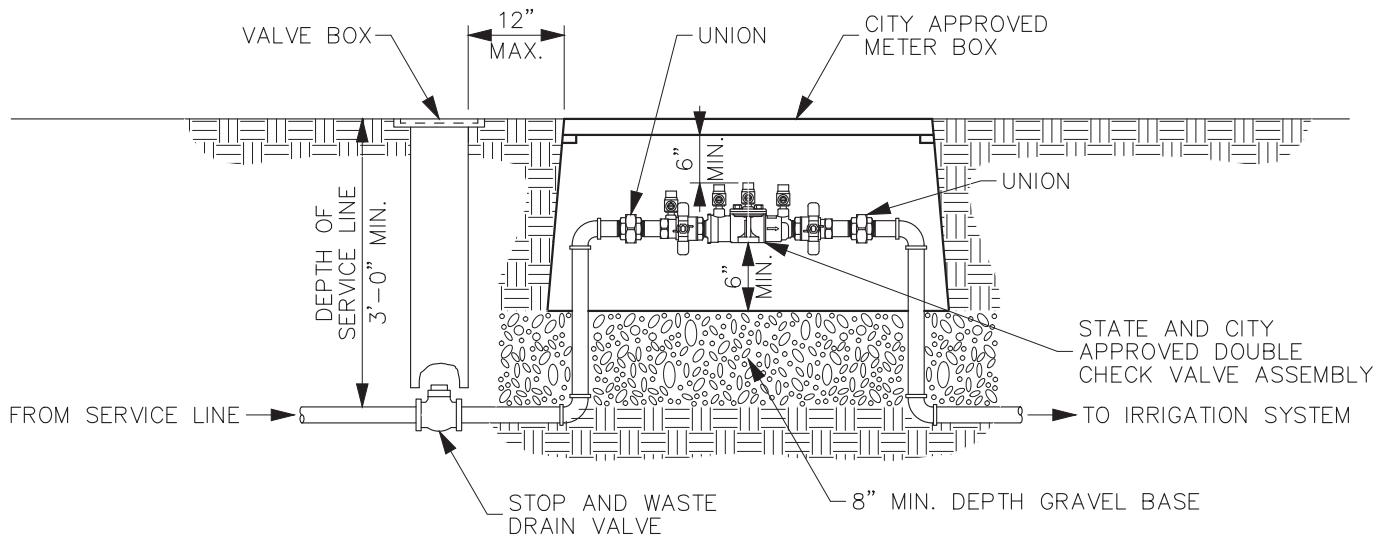

ELEVATION

NOTES:

1. DOUBLE CHECK VALVE ASSEMBLY SHALL MEET REQUIREMENTS OF THE AWWA "ACCEPTED PROCEDURE AND PRACTICE IN CROSS-CONNECTION CONTROL" MANUAL.
2. DEVICES MUST BE ON STATE DEPT. OF SOCIAL AND HEALTH SERVICES LIST OF "APPROVED CROSS CONNECTION CONTROL DEVICES".
3. METER BOX SIZE SHOULD BE SIZED TO PROVIDE THE MINIMUM CLEARANCES SHOWN IN THE DETAIL.

TYPICAL IRRIGATION BACKFLOW PREVENTER (3/4" - 2")

NOT TO SCALE

NOTES:

- ONLY THE LATEST DETAIL, AS APPROVED BY THE CITY DIRECTOR OF PUBLIC WORKS, SHALL BE USED.

| | | | |
|-------|-------|--|--|
| | | | |
| | | | |
| | | | |
| ORIG. | 12/07 | | |

Revision Date Description Appr